GENERAL NOTES

- A. ALL FIBER OPTIC CABLES ARE TO BE ROUTED IN 1" EMT CONDUIT ORANGE IN COLOR. NO LB'S OR CONDUIT BODIES ARE ALLOWED. PROVIDE MINIMUM 12"x12" J-BOXES WHERE REQUIRED. ALL J-BOXES TO BE ORANGE IN COLOR AND TO BE STENCILED "ENGINEERING FIBER OPTIC".
- B. PROVIDE ALL CUTTING AND PATCHING (INCLUDING FIRE STOPPING) OF FLOORS, WALLS, OR CEILINGS REQUIRED FOR THE FIRE ALARM SYSTEM, MATCH ADJACENT SURFACES.
- THESE DRAWINGS SHOW THE GENERAL LOCATIONS OF EXISTING FIRE ALARM CONTROL PANELS AND REMOTE FIRE ALARM ANNUNCIATORS. THE CONTRACTOR SHALL REMOVE ALL EXISTING CONTROL PANELS, ANNUNCIATORS AND ASSOCIATED FIRE ALARM NETWORK CONTROL COMPONENTS AND REPLACE WITH NEW ADDRESSABLE FIRE ALARM CONTROL PANELS, REMOTE FIRE ALARM ANNUNCIATORS AND ASSOCIATED COMPONENTS AS SHOWN ON THESE DRAWINGS AND OUTLINED IN THE SPECIFICATIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE EXACT LOCATIONS OF ALL EXISTING AND NEW
- NEW NETWORK FIRE ALARM CONTROL PANELS SHALL BE CONNECTED WITH A NEW FIBER OPTIC PATHWAY INSTALLED IN CONDUIT AND ARRANGED FOR DATA AND VOICE
- . THE EXISTING FIRE ALARM NETWORK IS AN EDWARDS IRC3 MULTIPLEX FIRE ALARM SYSTEM UTILIZING ANALOG ADDRESSABLE SIGNALING LINE CIRCUIT TECHNOLOGY. EXISTING ANALOG ADDRESSABLE INITIATING DEVICES, SIGNALING LINE CIRCUIT WIRING, NOTIFICATION APPLIANCES, NOTIFICATION APPLIANCE WIRING, AND CONTROL CIRCUIT WIRING SHALL REMAIN AND CONNECT TO NEW FIRE ALARM CONTROL PANELS. NEW FIRE ALARM CONTROL PANELS SHALL BE ARRANGED FOR COMPATIBILITY WITH EXISTING DEVICES, APPLIANCE AND CONTROL CIRCUITS. REFER TO SPECIFICATIONS FOR ADDITIONAL DETAILS.
- EXISTING NOTIFICATION APPLIANCE SIGNALING IS ACCOMPLISHED WITH CONVENTIONAL HORN/STROBES AND SHALL REMAIN. THE NEW NETWORK FIRE ALARM SYSTEM SHALL BE ARRANGED WITH CONNECTIONS AND COMPONENTS FOR A FUTURE UPGRADE TO DIGITAL EMERGENCY VOICE/ALARM COMMUNICATIONS AS REQUIRED BY THE SPECIFICATIONS.
- G. THE CONTRACTOR SHALL PROVIDE, INSTALL AND CONNECT NEW CONDUIT AND WIRING FOR A COMPLETE SYSTEM. ALL ABANDONED FIRE ALARM WIRING AND RACEWAY SHALL BE

H. SEE SPECIFICATIONS FOR INITIATING DEVICE, NOTIFICATION APPLIANCE CIRCUIT AND

CONTROL CIRCUIT SCHEDULES FOR EXISTING FIRE ALARM CONTROL PANELS. SEE SPECIFICATIONS FOR PHASING AND IMPAIRMENT REQUIREMENTS.


PLAN NOTES

- 1 DEMOLISH EXISTING FIRE ALARM CONTROL PANEL AND POWER SUPPLIES.
- 2 PROVIDE NEW NETWORK FIRE ALARM CONTROL PANEL. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- (3) PROVIDE NEW FIBER OPTIC TERMINATION CABINET.
- PROVIDE NEW 3/4"x4'x8' PAINTED, FIRE RETARDANT PLYWOOD BACKBOARD.
- (5) APPROXIMATE ROUTE OF NEW FIBER OPTIC CONDUITS/CABLES. VERIFY ACTUAL ROUTE WITH EXISTING CONDITIONS. REFER TO SITE PLAN ON FS100 FOR CONTINUATION.
- (6) DEMOLISH EXISTING FIRE ALARM CONTROL PANEL CIRCUIT COMPLETE BACK TO SOURCE. REMOVE CIRCUIT BREAKER LOCK AND PROVIDE NEW TYPED PANEL DIRECTORY.
- (7) PROVIDE NEW DEDICATED 120V/20A CIRCUIT FROM PANEL 10LB-N, CIRCUIT #13. PROVIDE NEW QOB 20A/1P CIRCUIT BREAKER, CIRCUIT BREAKER LOCK AND NEW TYPED
- 8 PROVIDE SMOKE DETECTOR AT NEW FIRE ALARM CONTROL PANEL LOCATION.

BUILDING 10 FIRE ALARM PLAN - BASEMENT

100% Construction Documents - For Construction



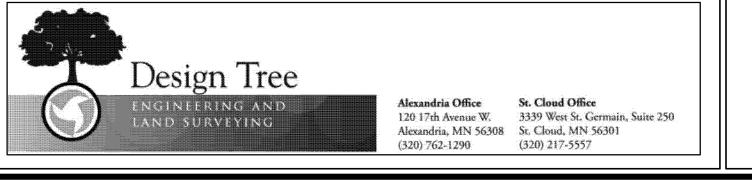



CHILFREY SCOA	
GENS	
12174	L
03/13/13 W TANSAS SONAL ENGINE	
TANSAS CITALISTONAL ENGINEE	

ACE.	BUILDING 10 FIRE PLAN - BASEMEN
	APPROVED: PROJECT DIRECTOR

FIRE ALARM REPLACEMENT 03.12.2013

St. Cloud VA

Health Care System PLOT SCALE AS NOTED T. CLOUD VA MEDICAL CENTER FA100-10
T. CLOUD, MN 56303